

GENTEX

710/713CS/LS 7109/7139CS/LS

Photoelectric Smoke Detector Single Station 120 VAC with Visual Signaling Appliance and Battery Backup

SERIES

Applications

The 710/713CS/LS and 7109/7139CS/LS photoelectric single station smoke detectors are designed to give reliable early warning of the presence of smoke where both audible and visual alarms are required. The series features a 90dB solid state piezo signal and a 177 Candela strobe with "FIRE" lettering. The strobe is listed per UL 1971.

The 713/7139 Series provides the temporal 3 evacuation tone as a standard feature. When testing the 713/7139 Series it may take up to 16 seconds longer to go in or out of alarm.

The smoke detector operates on the light scattering principle, a superior method of detection utilizing a pulsing LED light source and a photodiode sensor in a fully screened sensing chamber.

Every 4 to 5 seconds the pulsing LED emits an infrared beam that bypasses the photodiode under normal conditions. However, when smoke enters the sensing chamber, the infrared beam is deflected onto the sensor by the smoke particles. The LED pulse rate increases to 8 times the normal rate, and after the photodiode confirms that smoke is present for 2 consecutive pulses, it will produce the signal necessary to trip an alarm.

Upon activation, the detector will emit a 90dBA local audible signal and activate the high intensity strobe. During the alarm period the strobe will flash at a brightness of 177 Candela 60 times per minute. After the smoke has cleared from the detector, the unit will revert to the normal stand-by condition.



710CS



710LS



7109CS
(battery backup)



7109LS
(battery backup)

Standard Features

- 177 Candela Rating (UL1971)
- Solid State 90dBA Horn
- Nominal 2.5% Sensitivity
- 5-to-1 Signal-to-Noise Ratio
- Quadra-Port Smoke Entry
- Full Function Test Switch — Patented Three Position Test
- Fully Insect Screened
- Quick-Disconnect Wiring Harness (CS Models)
- 9 VDC Battery Back-Up (7109/7139CS/LS) w/Audible Low Battery Chirp

- Form C Auxiliary Relay Contacts for Remote Annunciation (CS Models)
- Tandem Connection up to 6 Detectors Per System (CS Models)
- 9 Foot Line Cord (LS Models)
- Mounting Hardware
- Warranty is 1 Year From Date of Purchase
- Dry Contacts Will Activate From the Tandem Wire
- 7109/7139 Series and 710/713 Series Are Inter-Connectable
- Visual Does Not Operate on Battery Back-Up
- Temporal 3 Evacuation Sounding Device (713/7139 Series)

Approvals



This symbol on the product's nameplate means it is Listed by UNDERWRITERS LABORATORIES, INC.

- UL 217
- Americans with Disabilities Act (ADA 4.28.3)
- BFP (City of Chicago)
- BS+A/MEA #285-91-E
- MSFM Listing #1929
- NFPA 72
- CSFM Listing #7257-569:104 (710/713CS/LS)
- CSFM Listing #7257-569:118 (7109/7139CS/LS)



Available Models

| Model Number | Operating Voltage | OPTIONS | | | | | |
|---------------|-------------------|---------------------|-------------------|----------------------|-----------------|------------------|-----------------------|
| | | Local 177 Cd Strobe | Local 90dBA Piezo | Tandem up to 6 Units | Form C Contacts | 9 Foot Line Cord | 9 VDC Battery Back-Up |
| 710CS/713CS | 120 VAC | • | • | • | • | | |
| 710LS/713LS | 120 VAC | • | • | | | • | |
| 7109CS/7139CS | 120 VAC/9 VDC | • | • | • | • | | • |
| 7109LS/7139LS | 120 VAC/9 VDC | • | • | | | • | • |

**"W" = Wall Mount
**"C" = Ceiling Mount

Note: Ceiling mount not available in line cord models.

Wiring Diagram

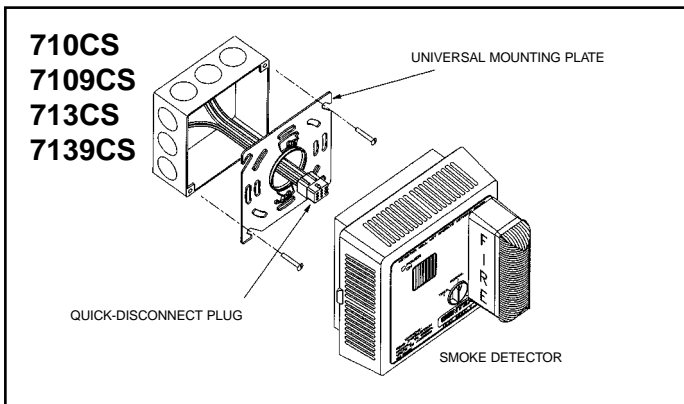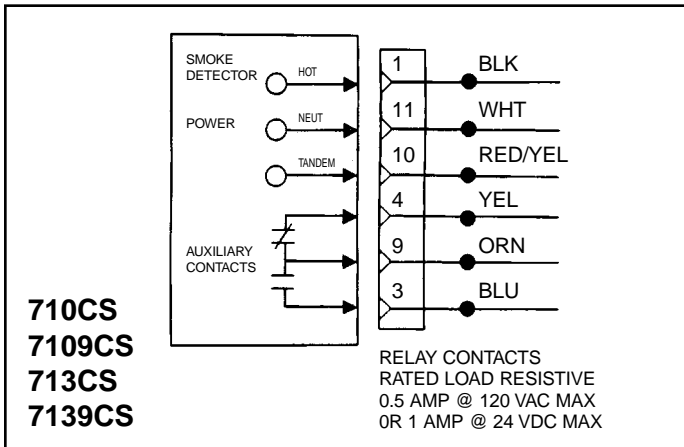

Electrical Specifications

| | |
|------------------------------|------------------------|
| Operating Voltage | 120 VAC, 60Hz |
| Operating Current | .0400 amps (Peak) |
| Operating Ambient Temp Range | .40°F to 100°F |
| Alarm Horn Rating | .90 Decibels at 10 Ft. |
| Nominal Sensitivity | .2.5% Obscuration |
| Auxiliary Relay (Standard) | .1 Form C (0.5 amp) |

(710/713CS and 7109/7139CS)

*9 VDC alkaline battery (supplied)

12 units per carton
21 pounds per carton

Strobe Rating

Candela Rating 177 Candela UL Listed Strobe Light
Flash Rate per Minute 60 Minimum

GENTEX CORPORATION

Fire Protection Products: www.gentex.com
10985 Chicago Dr., Box 310, Zeeland, MI 49464
616/392-7195 1-800/436-8391 FAX: 616/392-4219

Gentex corporation reserves the right to make changes to the product data sheets at their discretion.

Architect & Engineering Specifications

The Photoelectric Detector Shall be a Gentex Model 710/713LS/7109/7139LS or approved equal which shall provide at least the following features and functions.

- Nominal sensitivity shall be 2.5%.
- The detector shall utilize an infrared LED sensing circuit which pulses in 4 to 5 second intervals; when subjected to smoke the pulse rate shall increase 8 times. After 2 consecutive pulses in smoke, the detector will alarm.
- The detector shall provide minimum 5-to-1 signal-to-noise ratio in the optics frame to assure stability of operation in environments of high RF and transient conditions.
- The sensing chamber shall be fully screened to prevent entrance of small insects, thus reducing the probability of false alarms.
- A solid state piezo alarm rated at 90dBA at 10 ft.
- A visual LED monitor (condition indicator) will pulse in normal operation and steady on in alarm.
- The visual signal shall have a minimal light output of 177 Candela.
- An easily accessible test knob shall be provided. The test knob in the TEST position will simulate an actual smoke condition of approximately 3.5% causing the detector to alarm within 20-36 seconds. Also the detector shall test for the most sensitive setting. An alarm during this test will be a maintenance indicator.
- The detector shall be provided with a 9 foot line cord with a strain relief connection, if a portable unit.
- Unit must be capable of providing a monitored battery back-up.
- Unit must be UL 217 listed for wall mount.
- Unit shall also meet all requirements of the State of California Fire Marshal, Bureau of Standards and Appeals and the Americans with Disabilities Act (ADA).

Architect & Engineering Specifications

The Photoelectric Detector Shall be a Gentex Model 710/713CS/7109/7139CS or approved equal which shall provide at least the following features and functions.

- Nominal sensitivity shall be 2.5%.
- The detector shall utilize an infrared LED sensing circuit which pulses in 4 to 5 second intervals; when subjected to smoke the pulse rate shall increase 8 times. After 2 consecutive pulses in smoke, the detector will alarm.
- The detector shall provide minimum 5-to-1 signal-to-noise ratio in the optics frame to assure stability of operation in environments of high RF and transient conditions.
- The sensing chamber shall be fully screened to prevent entrance of small insects, thus reducing the probability of false alarms.
- A solid state piezo alarm rated at 90dBA at 10 ft.
- A visual LED monitor (condition indicator) will pulse in normal operation and will remain solid in alarm.
- The visual signal shall have a minimal light output of 177 Candela and will flash one time per second.
- An easily accessible test knob shall be provided. The test knob in the TEST position will simulate an actual smoke condition of approximately 3.5% causing the detector to alarm within 20-36 seconds. Also the detector shall test for the most sensitive setting. An alarm during this test will be a maintenance indicator. Return to Gentex for maintenance.
- The detector shall be provided with a Form C contact for remote annunciation purposes.
- The manufacturer shall provide other compatible detector models with the following optional features: a) auxiliary Form C relay contact for initiating remote functions and annunciation; b) relay option that is capable of activation by tandem interconnect wire.
- Unit must be capable of providing a monitored battery back-up.
- Unit must be UL 217 and UL 1971 listed for wall mount.
- Unit shall also meet all requirements of the State of California Fire Marshal, Bureau of Standards and Appeals and the Americans with Disabilities Act (ADA).

All equipment shall be completely factory assembled, wired and tested, and the contractor shall be prepared to submit a certified letter testifying to this condition. Detectors which do not meet all of the requirements of this specification will not be considered.

